



Pony Testing International Group

IP54 TEST REPORT

Applicant: Shanghai Leipold Electric Co., Ltd

The following sample(s) was/were submitted and identified on behalf of the client as:

Sample Name: Fan and filterSample Model FKL6626.230-D/FKL6626.230Sample Quantity: 1pcsSample Received Date: Jul.23, 2015Test Period: Jul.28, 2015 To Aug.05, 2015

DECLARATIONS:

The test(s) shown in the attachment were conducted according to the indicating procedures.

We assume full responsibility for the accuracy and completeness of these tests and vouch for the qualifications of all personnel performing them.

	Name	Signature	Date
Edited by	Huang Wei	Huang Wei	Aug.06,2015
Checked by	He Mina	He Mina	Aug.06,2015
Approved by	Kobe Wang	Kobe Wang	Aug.06,2015

www.ponytest.com

☎Hotline 400-819-5688

Add: Yuezhi Building, No.49-3, Suzhou Road, Haidian District, Beijing
Tel: (010)82618116Building 35, No.680, Guiping Road, Xuhui District, Shanghai
(021)64851999Building 6, Zhongxing Industry City, Chuangye Road, Nanshan District, Shenzhen
(0755)260509096th Floor, No.190, Zhuzhou Road, Laoshan District, Qingdao
(0532)88706866Add: Yinglun Building, Hongqi Road, Nankai District, Tianjin
Tel: (022)27360730Phase 2 Building 4, No.150 Xinhui Rd, Gaoxin Dist, Ningbo City
(0574)87736499Building 3, No.189 Hai Zhu Tech park, Qunle Road, Hai Zhu District, Guangzhou
(020)89224310



Pony Testing International Group

No.: BZHE2FHZ09087720

Page: 2 of 4

1. DESCRIPTION OF TEST EQUIPMENT

Test Equipment	Equipment Manufacturer	Equipment Model	Equipment No.	Validity Date
Dust tester	Linpin	SC-010	IE305	—
Liquid-in-glass Thermometers for Working	—	—	—	2016-05-14
Flexible rule	—	—	—	2016-03-04
Piezometer	—	—	—	2016-04-29

2. LABORATORY AMBIENCE CONDITION

Temperature : 25°C±10°C

Relative humidity : 50 %±25 %

3. REFERENCE DOCUMENT

The test according to GB 4208-2008、IEC 60529-2001 and the applicant's requirement

4. TEST CONDITION

4.1 IP5X

Test Dust	Talcum powder
Dust Density	2kg/m ³
Dust Size	<75μm
Dust Orientation	From bottom to down
Test time	5 samples in 4 batchs, 8h/batch, total 40h

4.2 IPX4

Total test time	5min
Water pressure	100kPa
Distance	400mm
Surface area	<1m ²

5. TEST RESULT

5.1 IP5X

After test, Sample with no abnormalities, normal to operation before and after test.

5.2 IPX4

After test, the sample's function with no abnormalities.

www.ponytest.com ☎Hotline 400-819-5688

PONY 谱尼测试
Pony Testing International Group

BeijingLab: (010) 82618116 ChangchunLab: (0431) 85150908 ShanghaiLab: (021) 64851999 ShenzhenLab: (0755) 26050909
QingdaoLab: (0532) 88706866 DalianLab: (0411) 84650820 NingboLab: (0574) 87736499 GuangzhouLab: (020) 89224310
TianjinLab: (022) 27360730 ZhengzhouLab: (0371) 69350670 HangzhouLab: (0571) 87219096 WuhanLab: (027) 83997127




Pony Testing International Group

No.: BZHE2FHZ09087720

Page: 3 of 4

Appendix 1: The photo of sample IP5X test

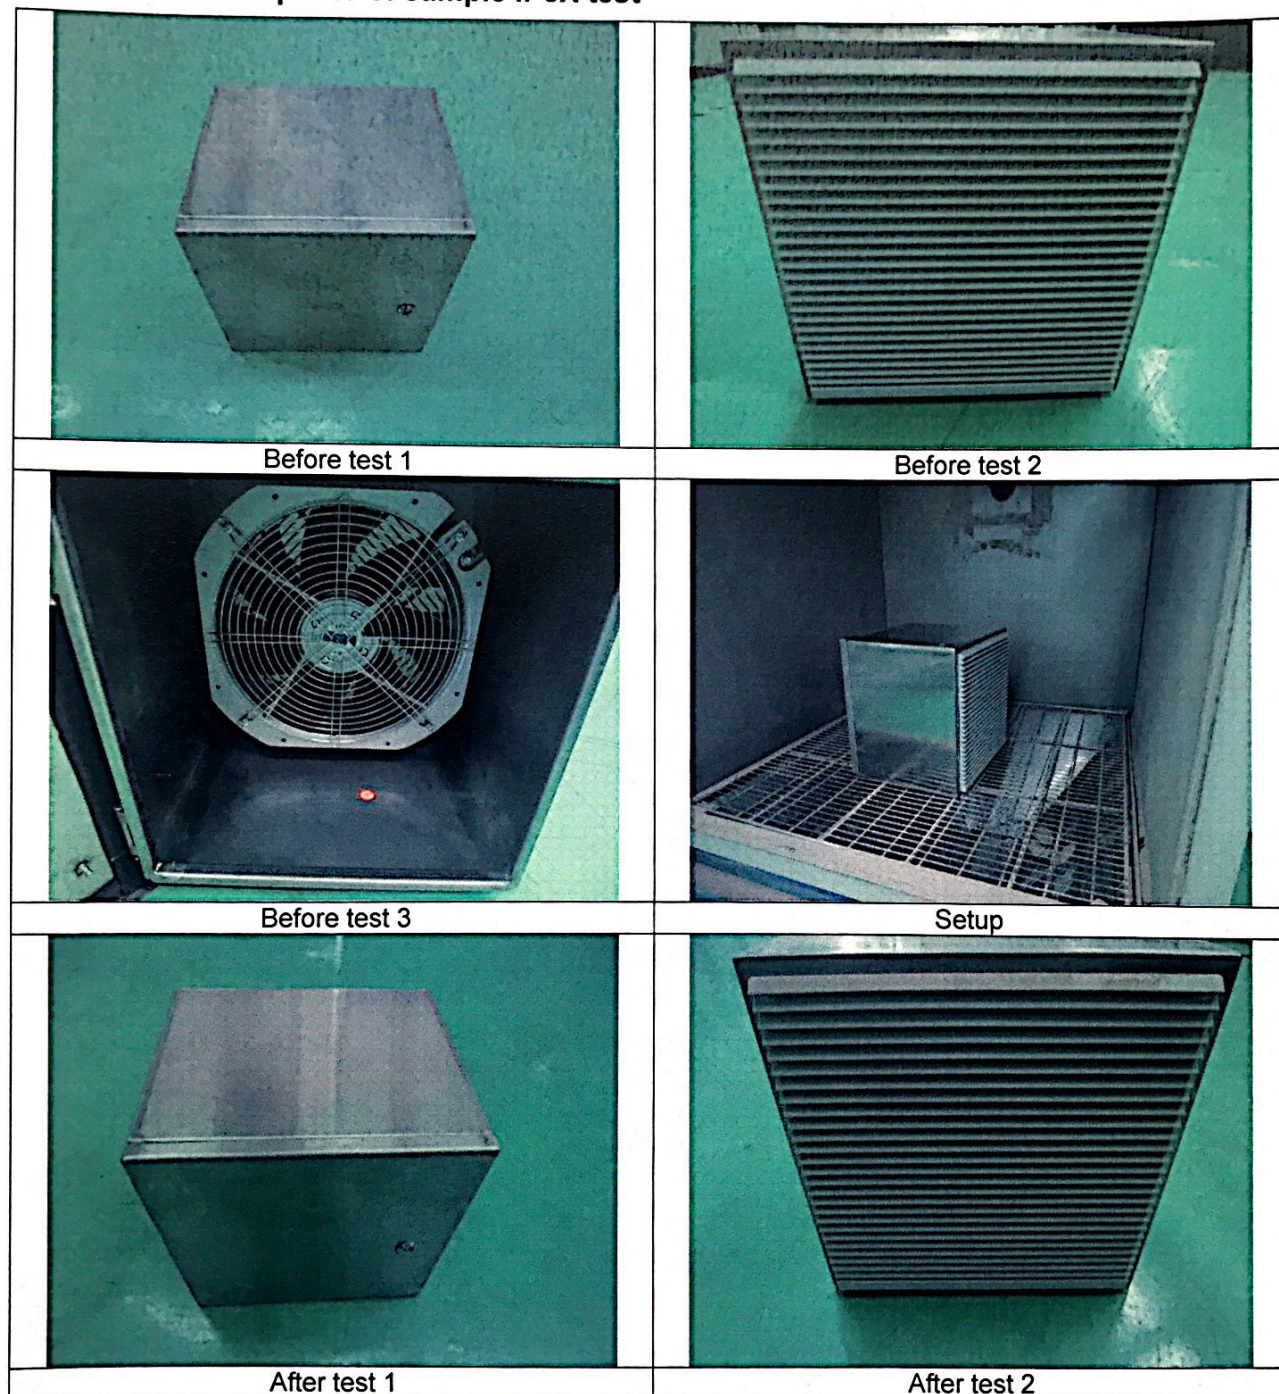

NAL
ELE
3N
专用
QJ

www.ponytest.com

☎Hotline 400-819-5688

PONY 谱尼测试
Pony Testing International Group

BeijingLab: (010) 82618116

QingdaoLab: (0532) 88706866

TianjinLab: (022) 27360730

ChangchunLab: (0431) 85150908

DalianLab: (0411) 84650820

ZhengzhouLab: (0371) 69350670

ShanghaiLab: (021) 64851999

NingboLab: (0574) 87736499

HangzhouLab: (0571) 87219096

ShenzhenLab: (0755) 26050909

GuangzhouLab: (020) 89224310

WuhanLab: (027) 83997127




Pony Testing International Group


No.: BZHE2FHZ09087720

Page: 4 of 4

Appendix 1: The photo of sample IP5X test (Continue)

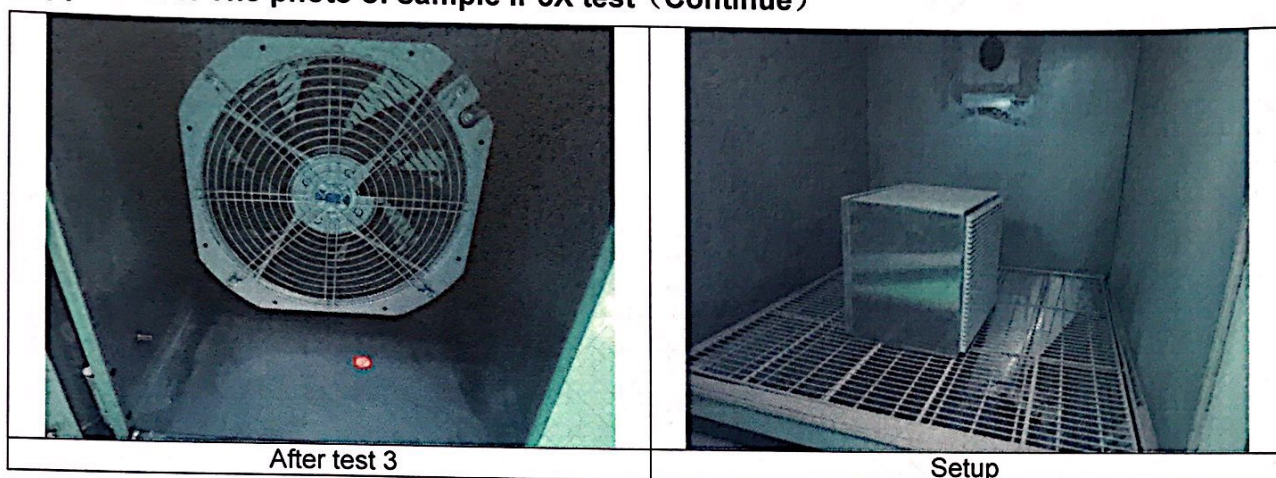

Appendix 2: The photo of sample IPX4 test

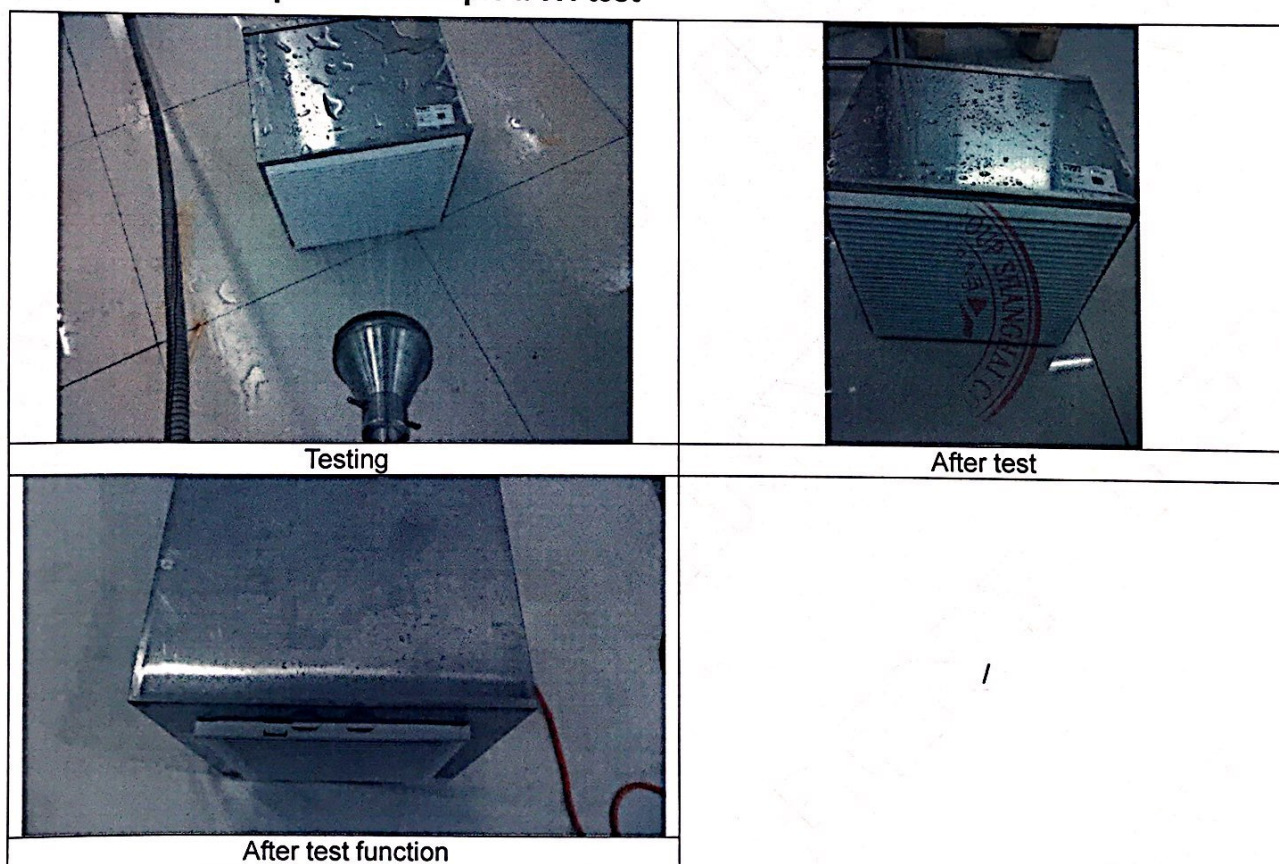

*** End of Report ***